




PLAN

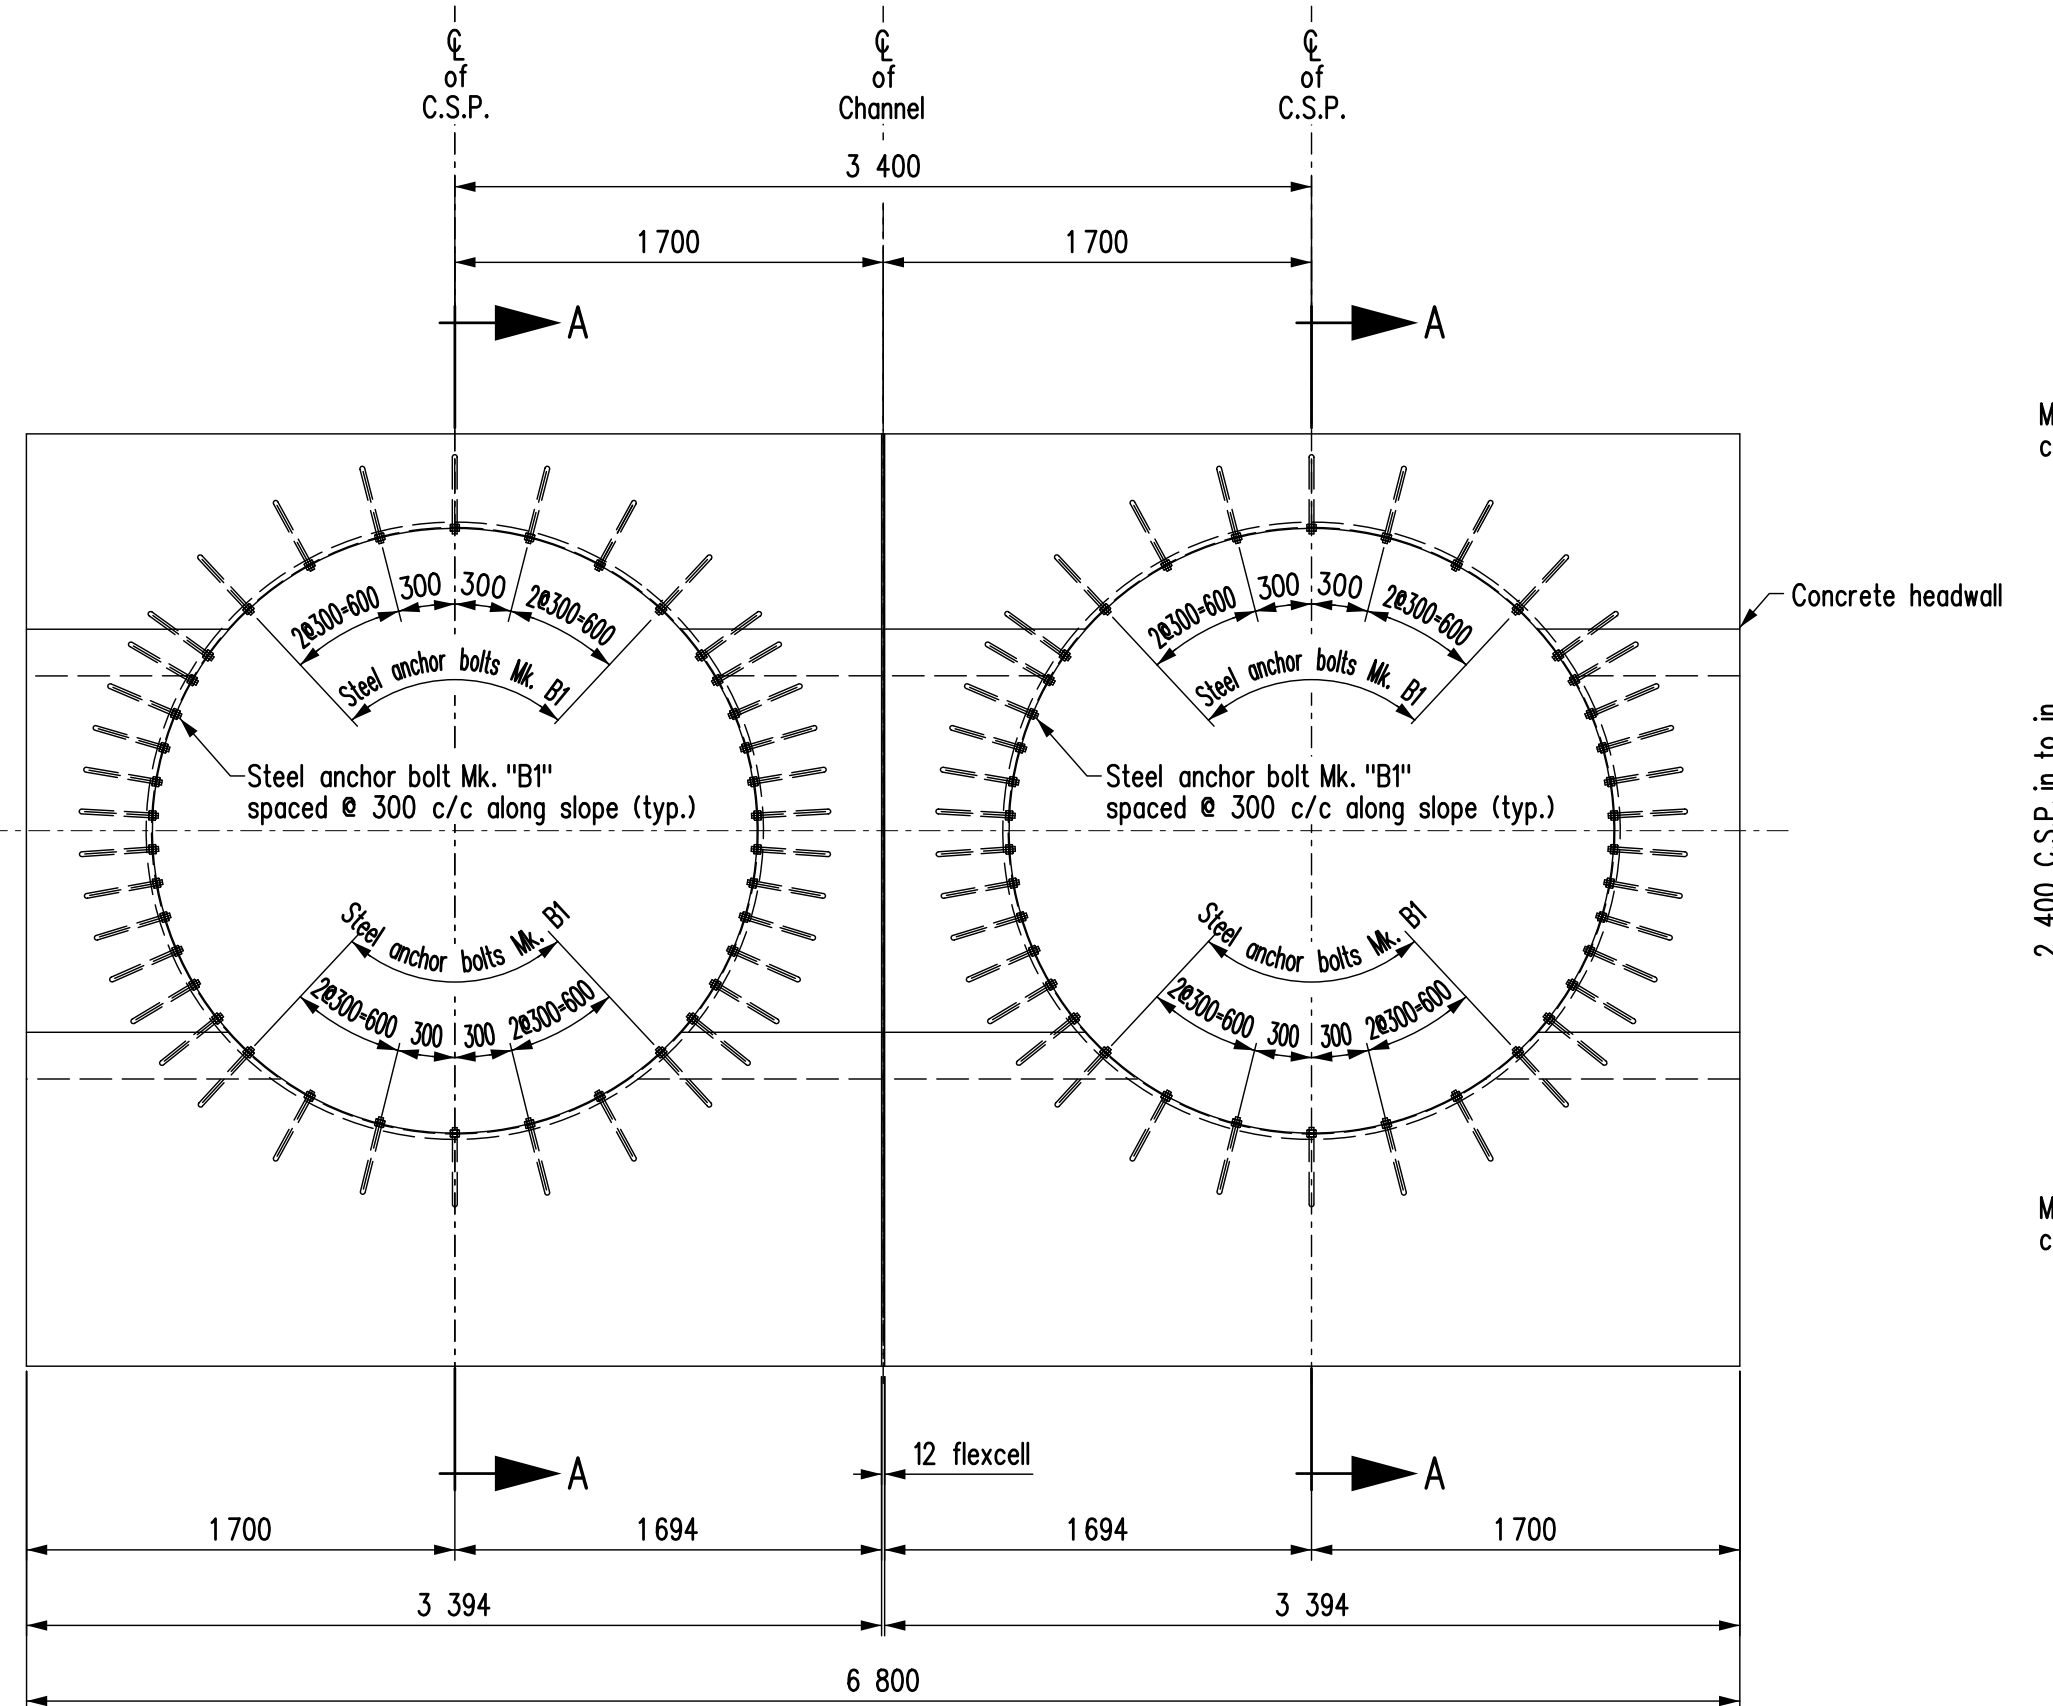

ELEVATION

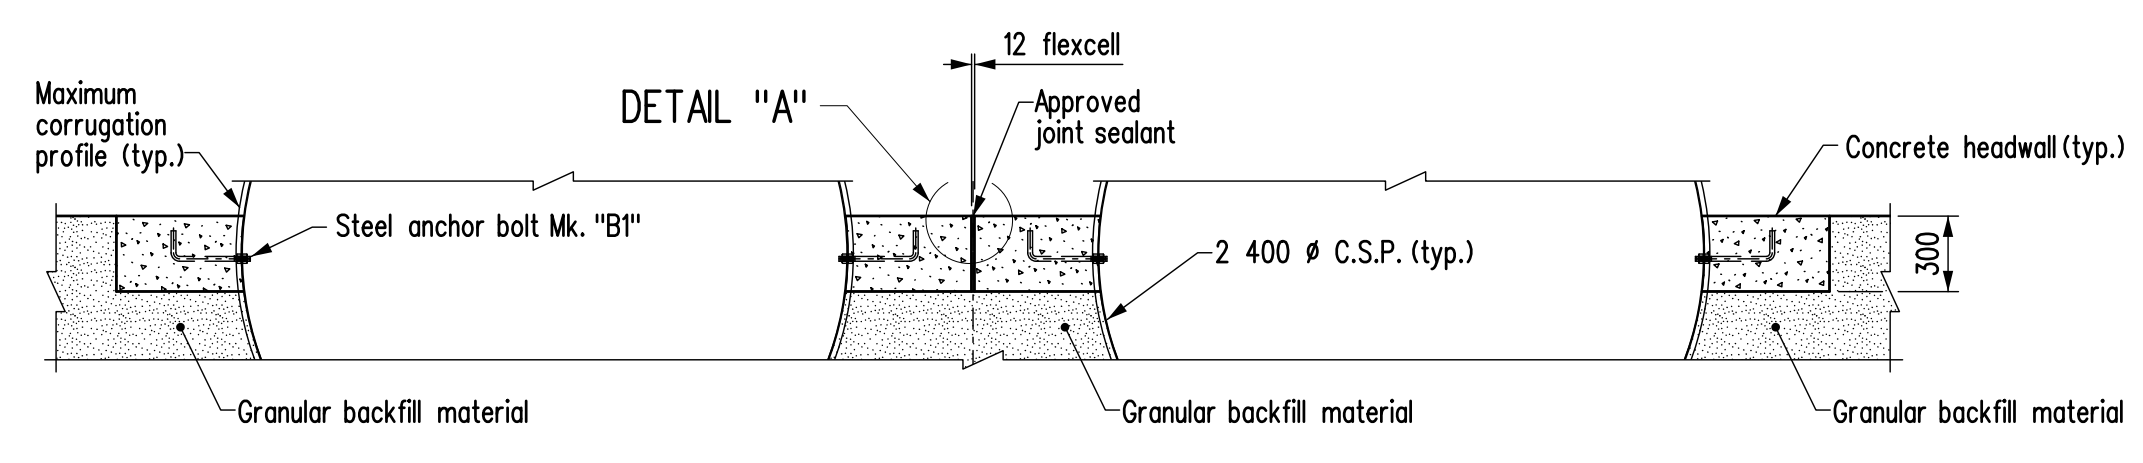


SECTION B-B

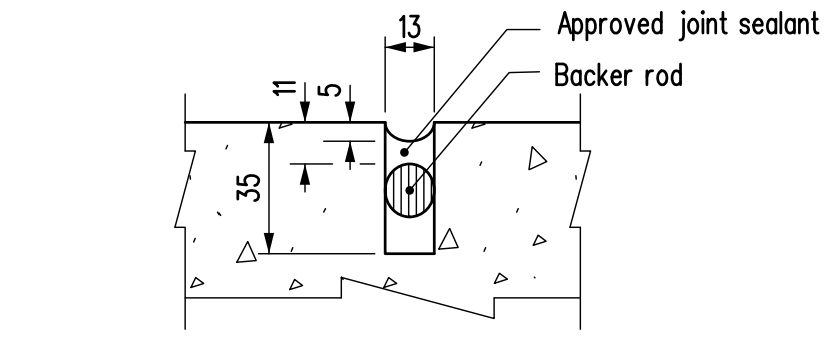


ALTERNATE JOINT DETAIL "A"

Centered between C.S.P.'S
Scale 1:2

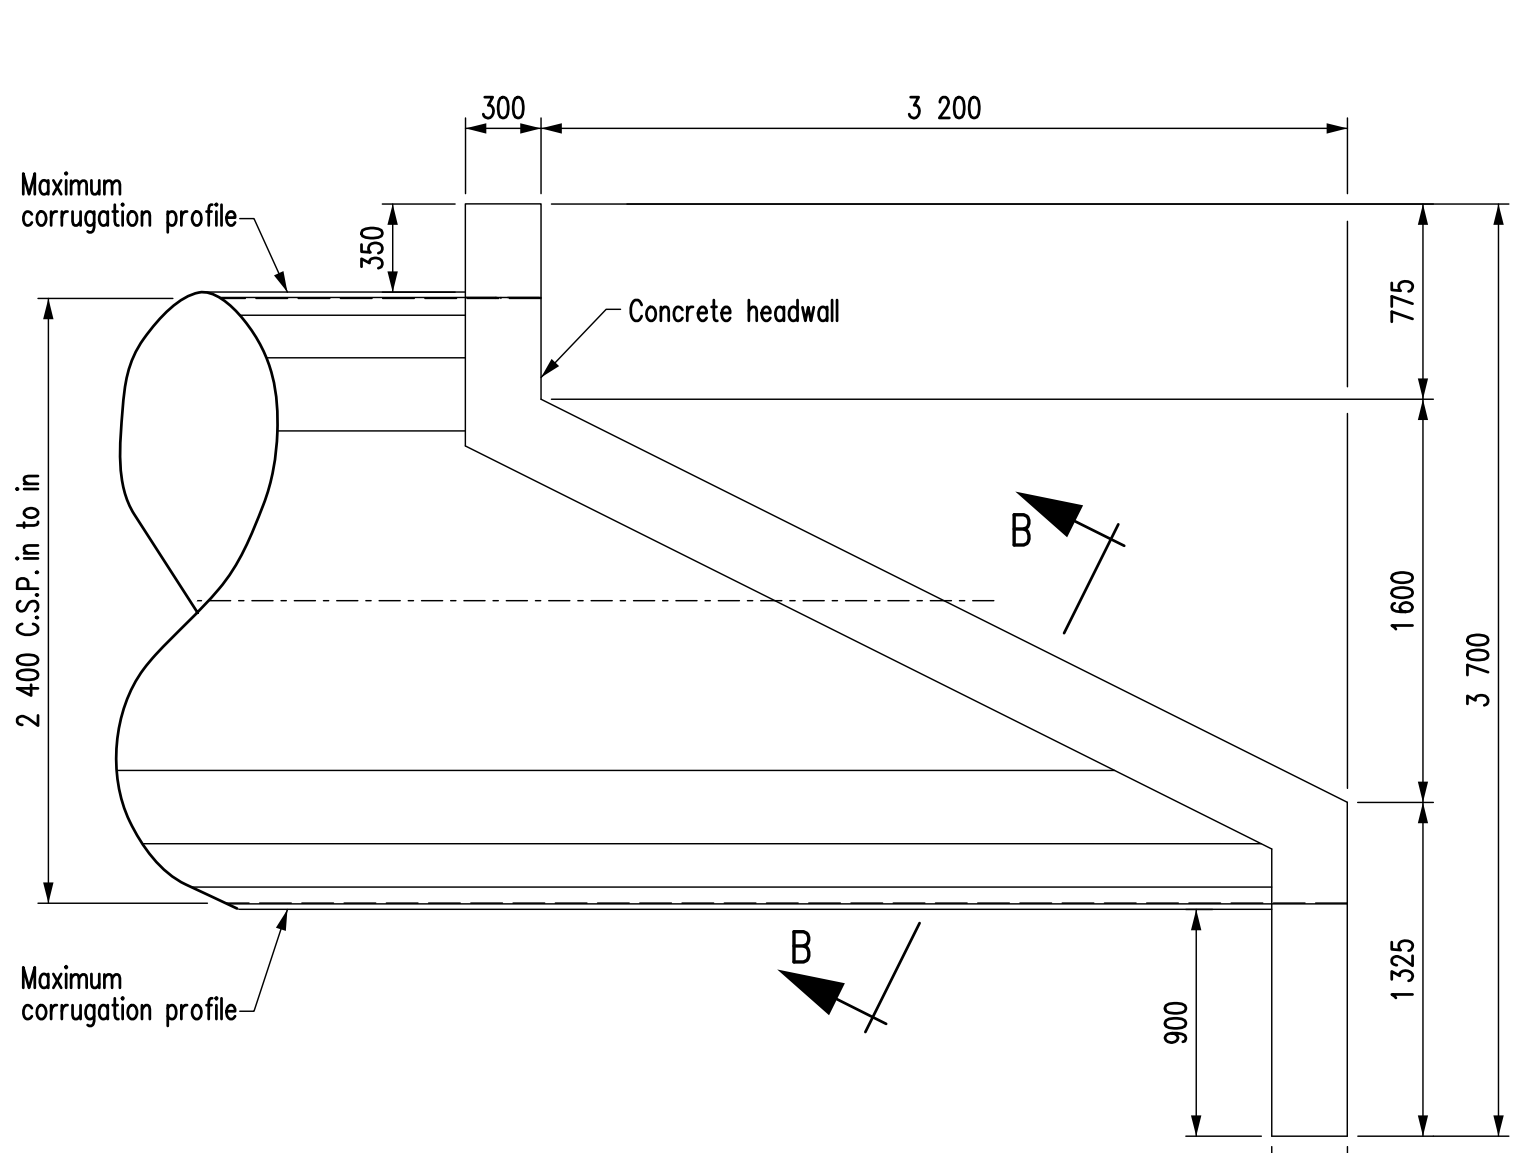

SIDE ELEVATION

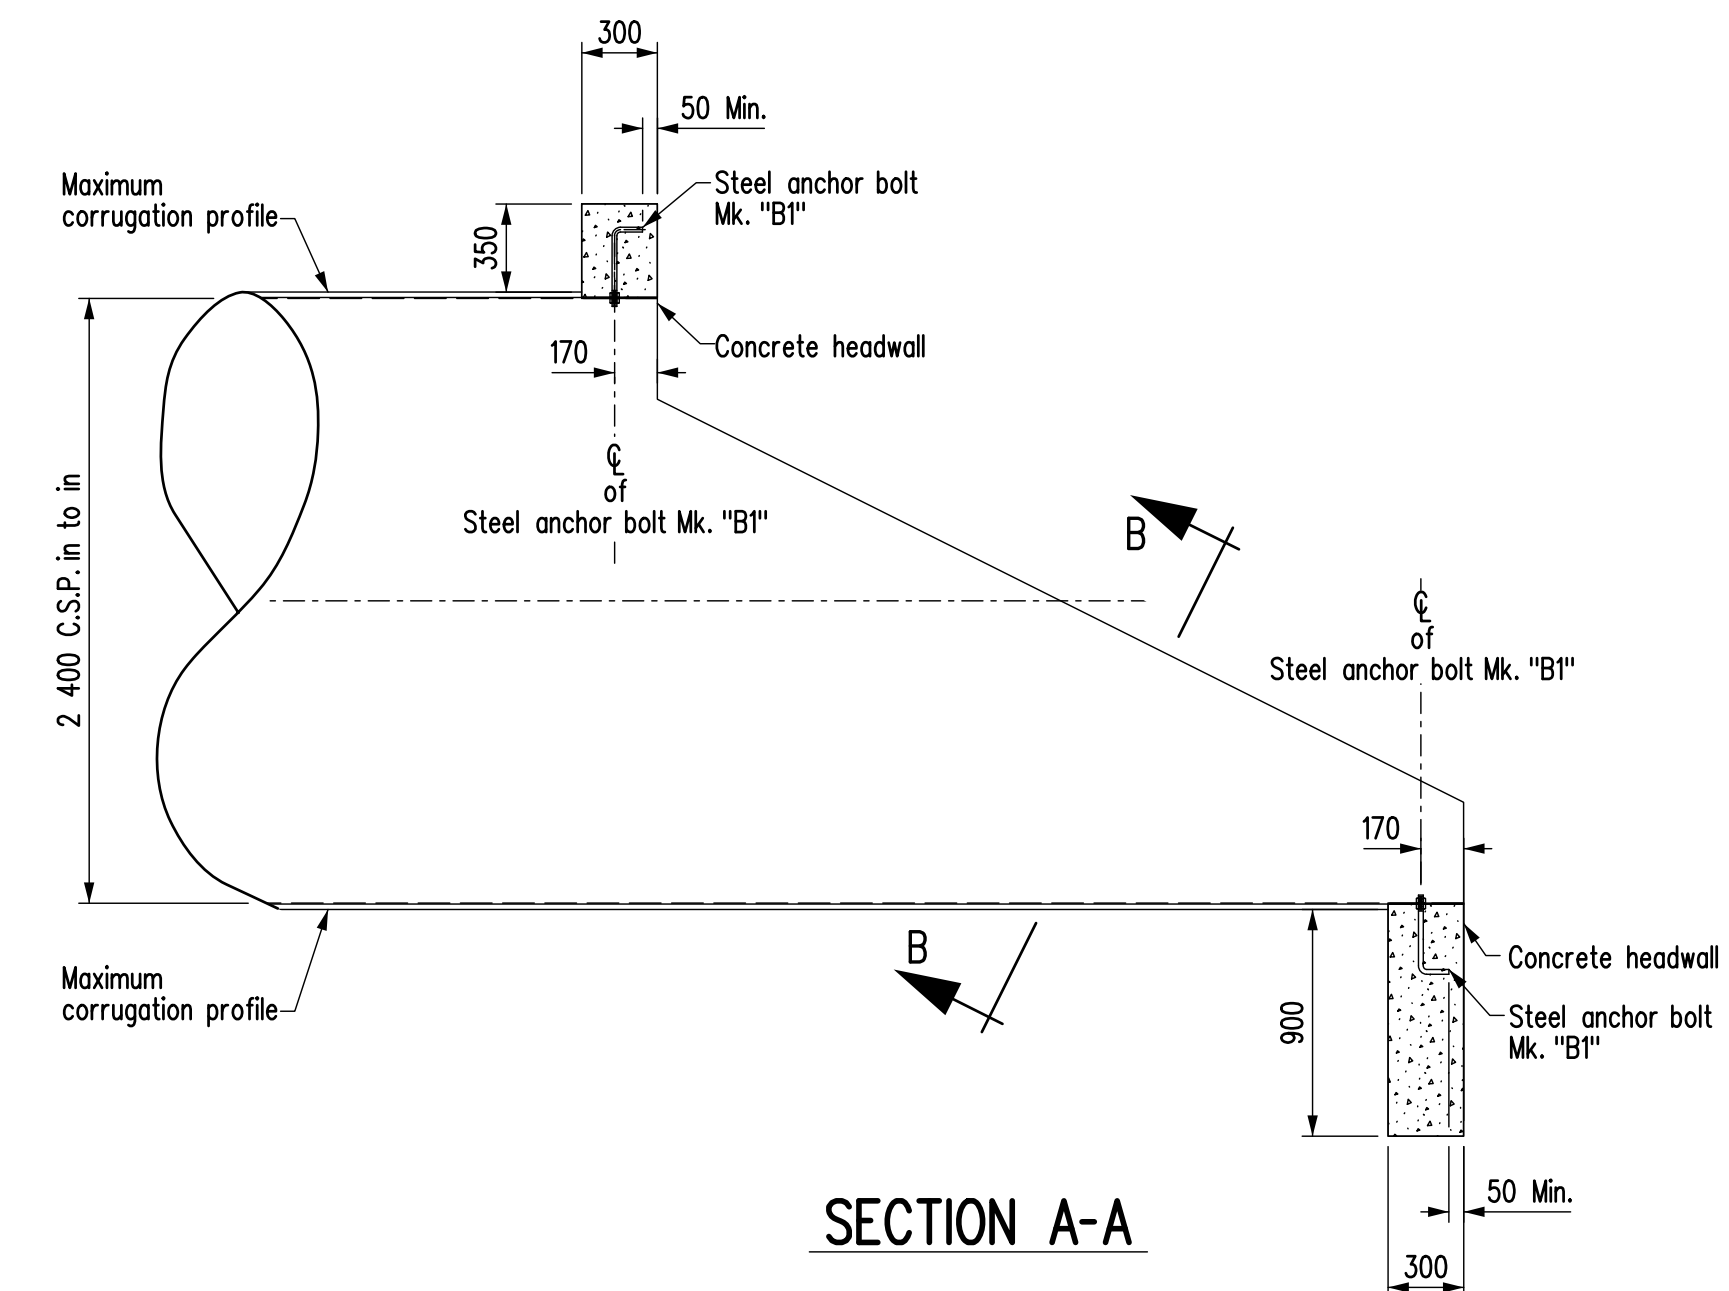

SECTION A-A

DESIGN DATA


SPECIFICATIONS
AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SEVENTH EDITION, 2014

STRUCTURAL CONCRETE

COMPRESSIVE STRENGTH $f_c = 35 \text{ MPa}$
 CEMENT CSA A23.1, CLASS C-1
 EXPOSURE CLASS AIR CATEGORY 1
 REINFORCING STEEL CAN/CSA G30.18-M92 GRADE 400W
 CLEAR COVER 50 mm (UNLESS NOTED OTHERWISE)

BILL OF MISCELLANEOUS METAL									
MARK No.	No.	DESCRIPTION	CORROSION PROTECTION	SIZE	LENGTH	REMARKS	MASS PER UNIT	MASS	
B1	152	Steel anchor bolt Grade A36 or 307	Hot dip galvanized	19 dia.	406	As detailed, c/w 2 hex. nuts Grade C & 2 flat washers	1.138	172.98	
TOTAL MASS kg =							172.98		

NOTES:
 1. All material noted in the above Bill shall be hot dip galvanized after fabrication in accordance with CSA G164 for a minimum net retention of 610 g/m² unless otherwise stated in the specified material ASTM standards. The fabricator and galvanizer shall safeguard against embrittlement using recommended practices from applicable standards.
 2. Grade C galvanized nuts for A36/307 bolts shall be overlapped to the minimum amount required for the fastener assembly in accordance with ASTM A563.
 3. All bolts and threaded rods in the above Bill shall be Imperial thread.

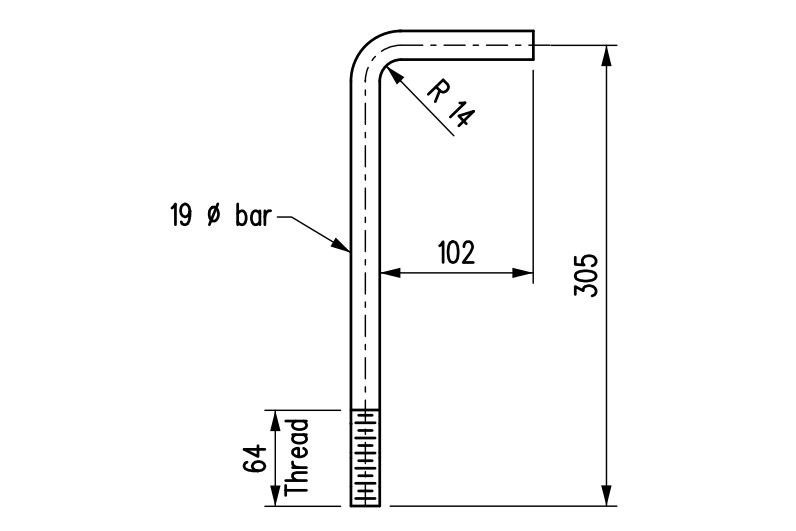


STEEL ANCHOR BOLT Mk. "B1"


Scale 1:5

- NOTES:
- Pour panels independently with 12 mm flexcell joint as shown or alternately cast the panels monolithically and use joint detail as shown in the Alternate Joint Detail "A". With either method of construction seal the joint(s) with an approved joint sealant.
 - All exposed surfaces of concrete headwalls to be permeable formwork liner finish.
 - All exposed edges of headwalls to be chamfered 25 mm except where noted otherwise.
 - 2 400 mm ϕ Corrugated Steel Pipe (CSP) end treatment assumed to have 2:1 beveled ends with 300 mm top and bottom steps. Also known as "standard slope" ends.
 - Assumed maximum 25 mm corrugation depth.
 - This standard is for culverts designed for a zero degree skew. A maximum of 15 degree skew is permissible provided that:
 - The headwall is constructed perpendicular to the axis of the culvert and
 - The roadway side slope is modified (widening and flattening of the slope at the obtuse corners) to accommodate the headwall geometry.


REVISIONS		HEADWALL DETAILS (CONCRETE) FOR 2 - 2 400 ϕ C.S.P.'S	
DATE	BY	DESIGN SEAL	RECORD SEAL
20/01/16	A.H.P.	Added washers & deleted damp proofing	
APPROVED BY:		APPROVED BY:	
Original signed by Ruth Eden		Original signed by Ruth Eden	
EXECUTIVE DIRECTOR OF STRUCTURES		EXECUTIVE DIRECTOR OF STRUCTURES	
DATE: June 5, 2014		DATE: June 5, 2014	
SCALE: 1:30		SCALE: 1:30	
SHEET No. 1 of 2		SHEET No. 1 of 2	
OF QS. SHOWN		OF QS. SHOWN	
STD. NO. SC_ET_RCH_NS_2-2400		STD. NO. SC_ET_RCH_NS_2-2400	

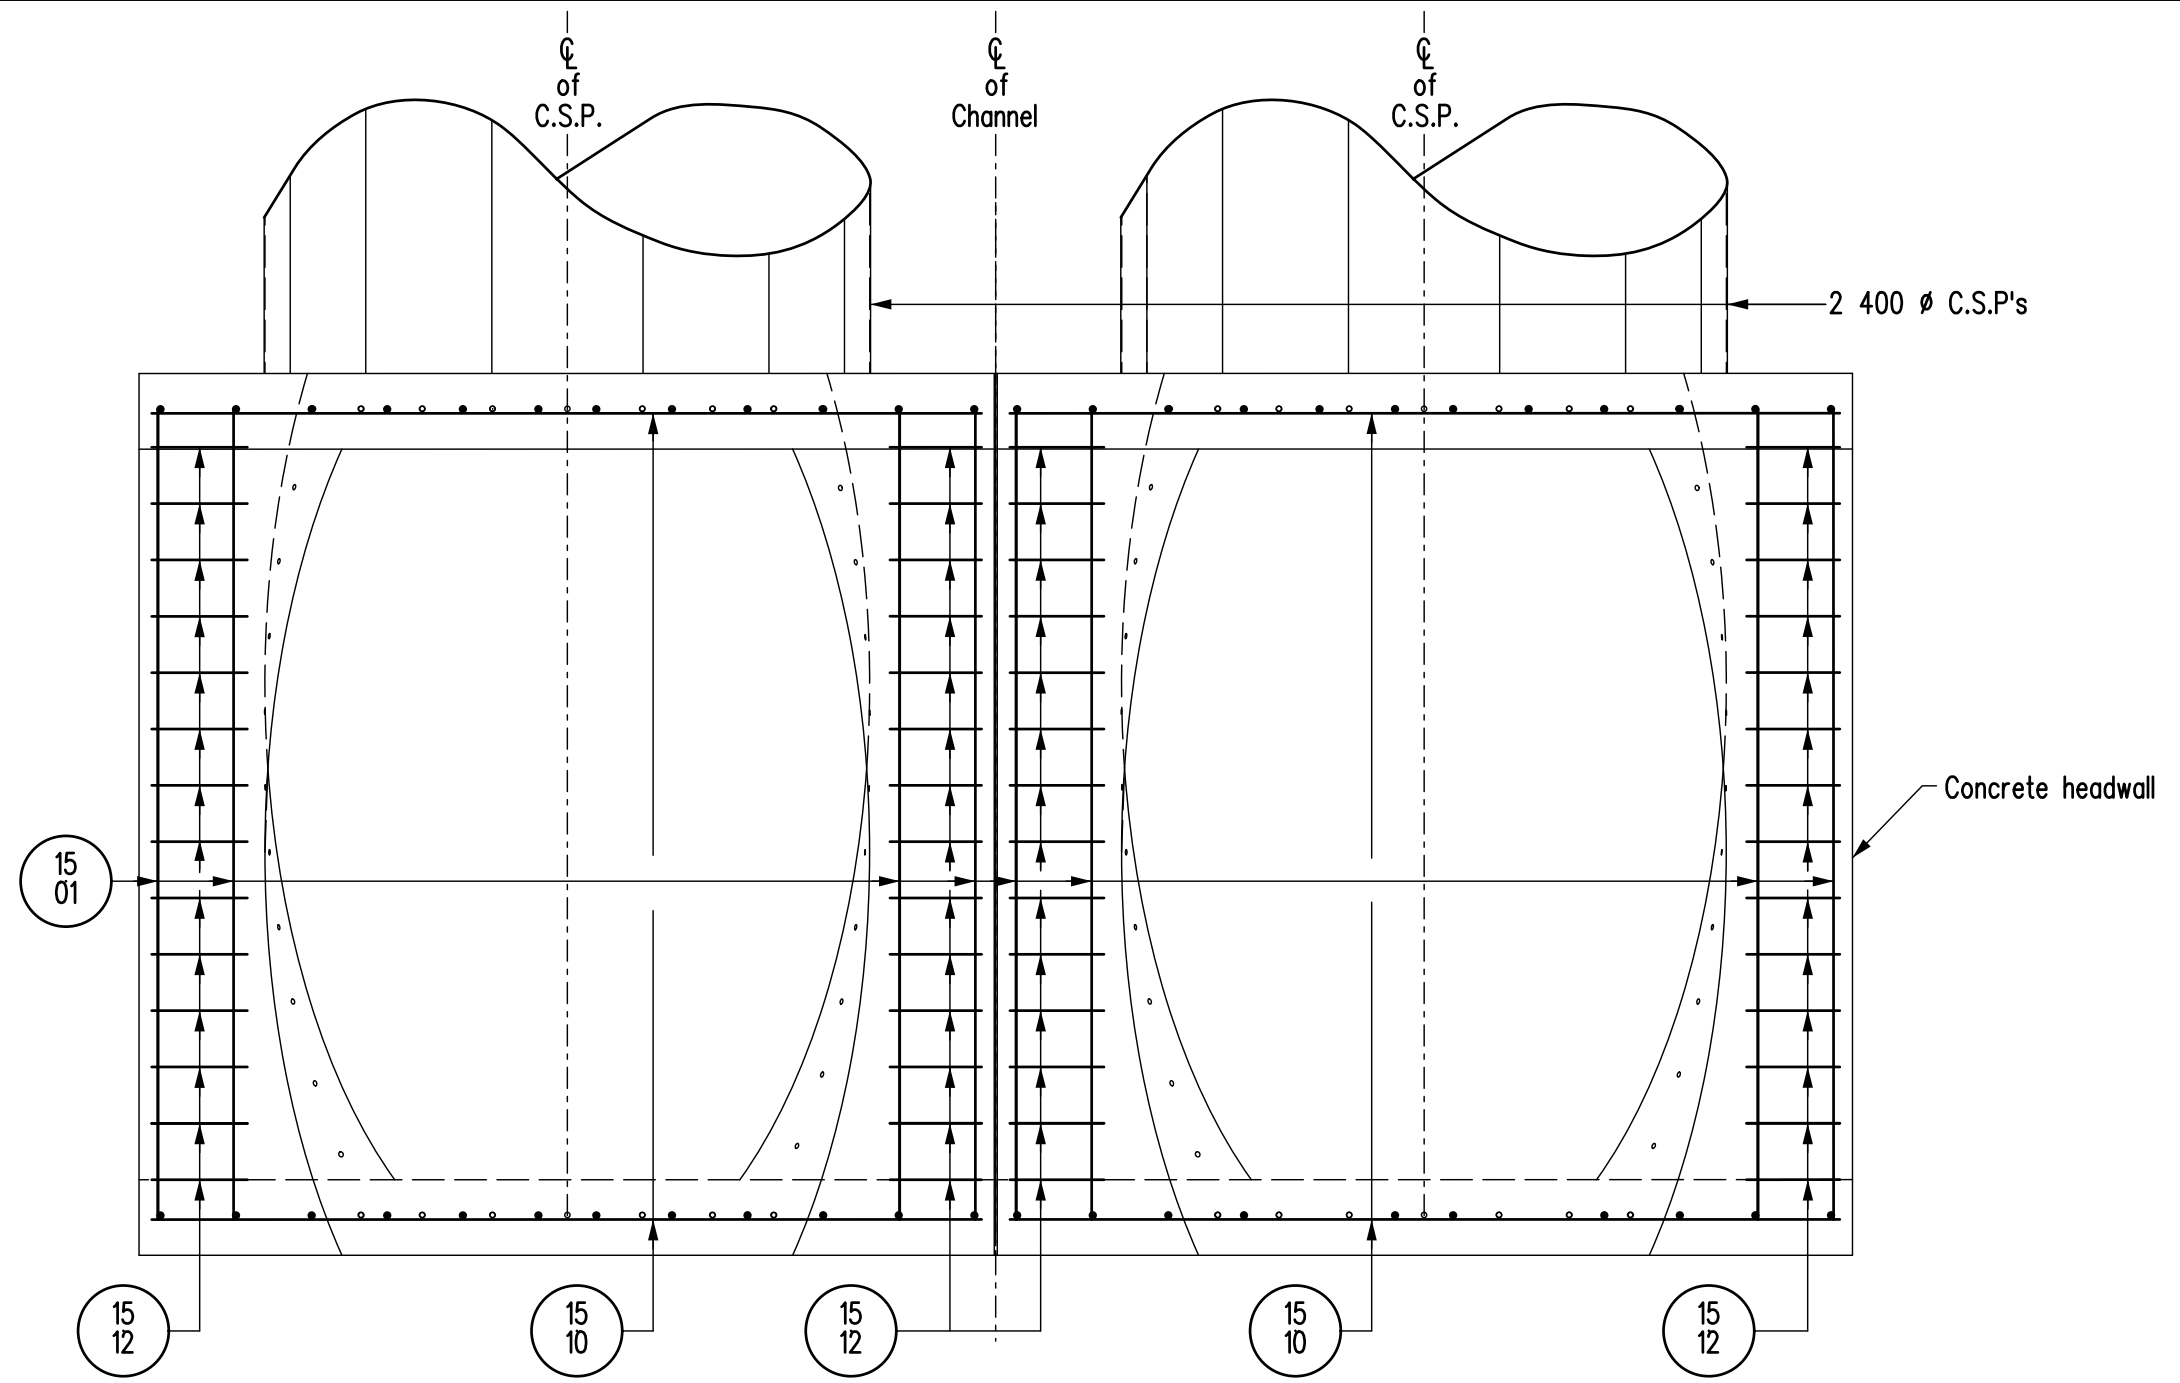

PART PLAN

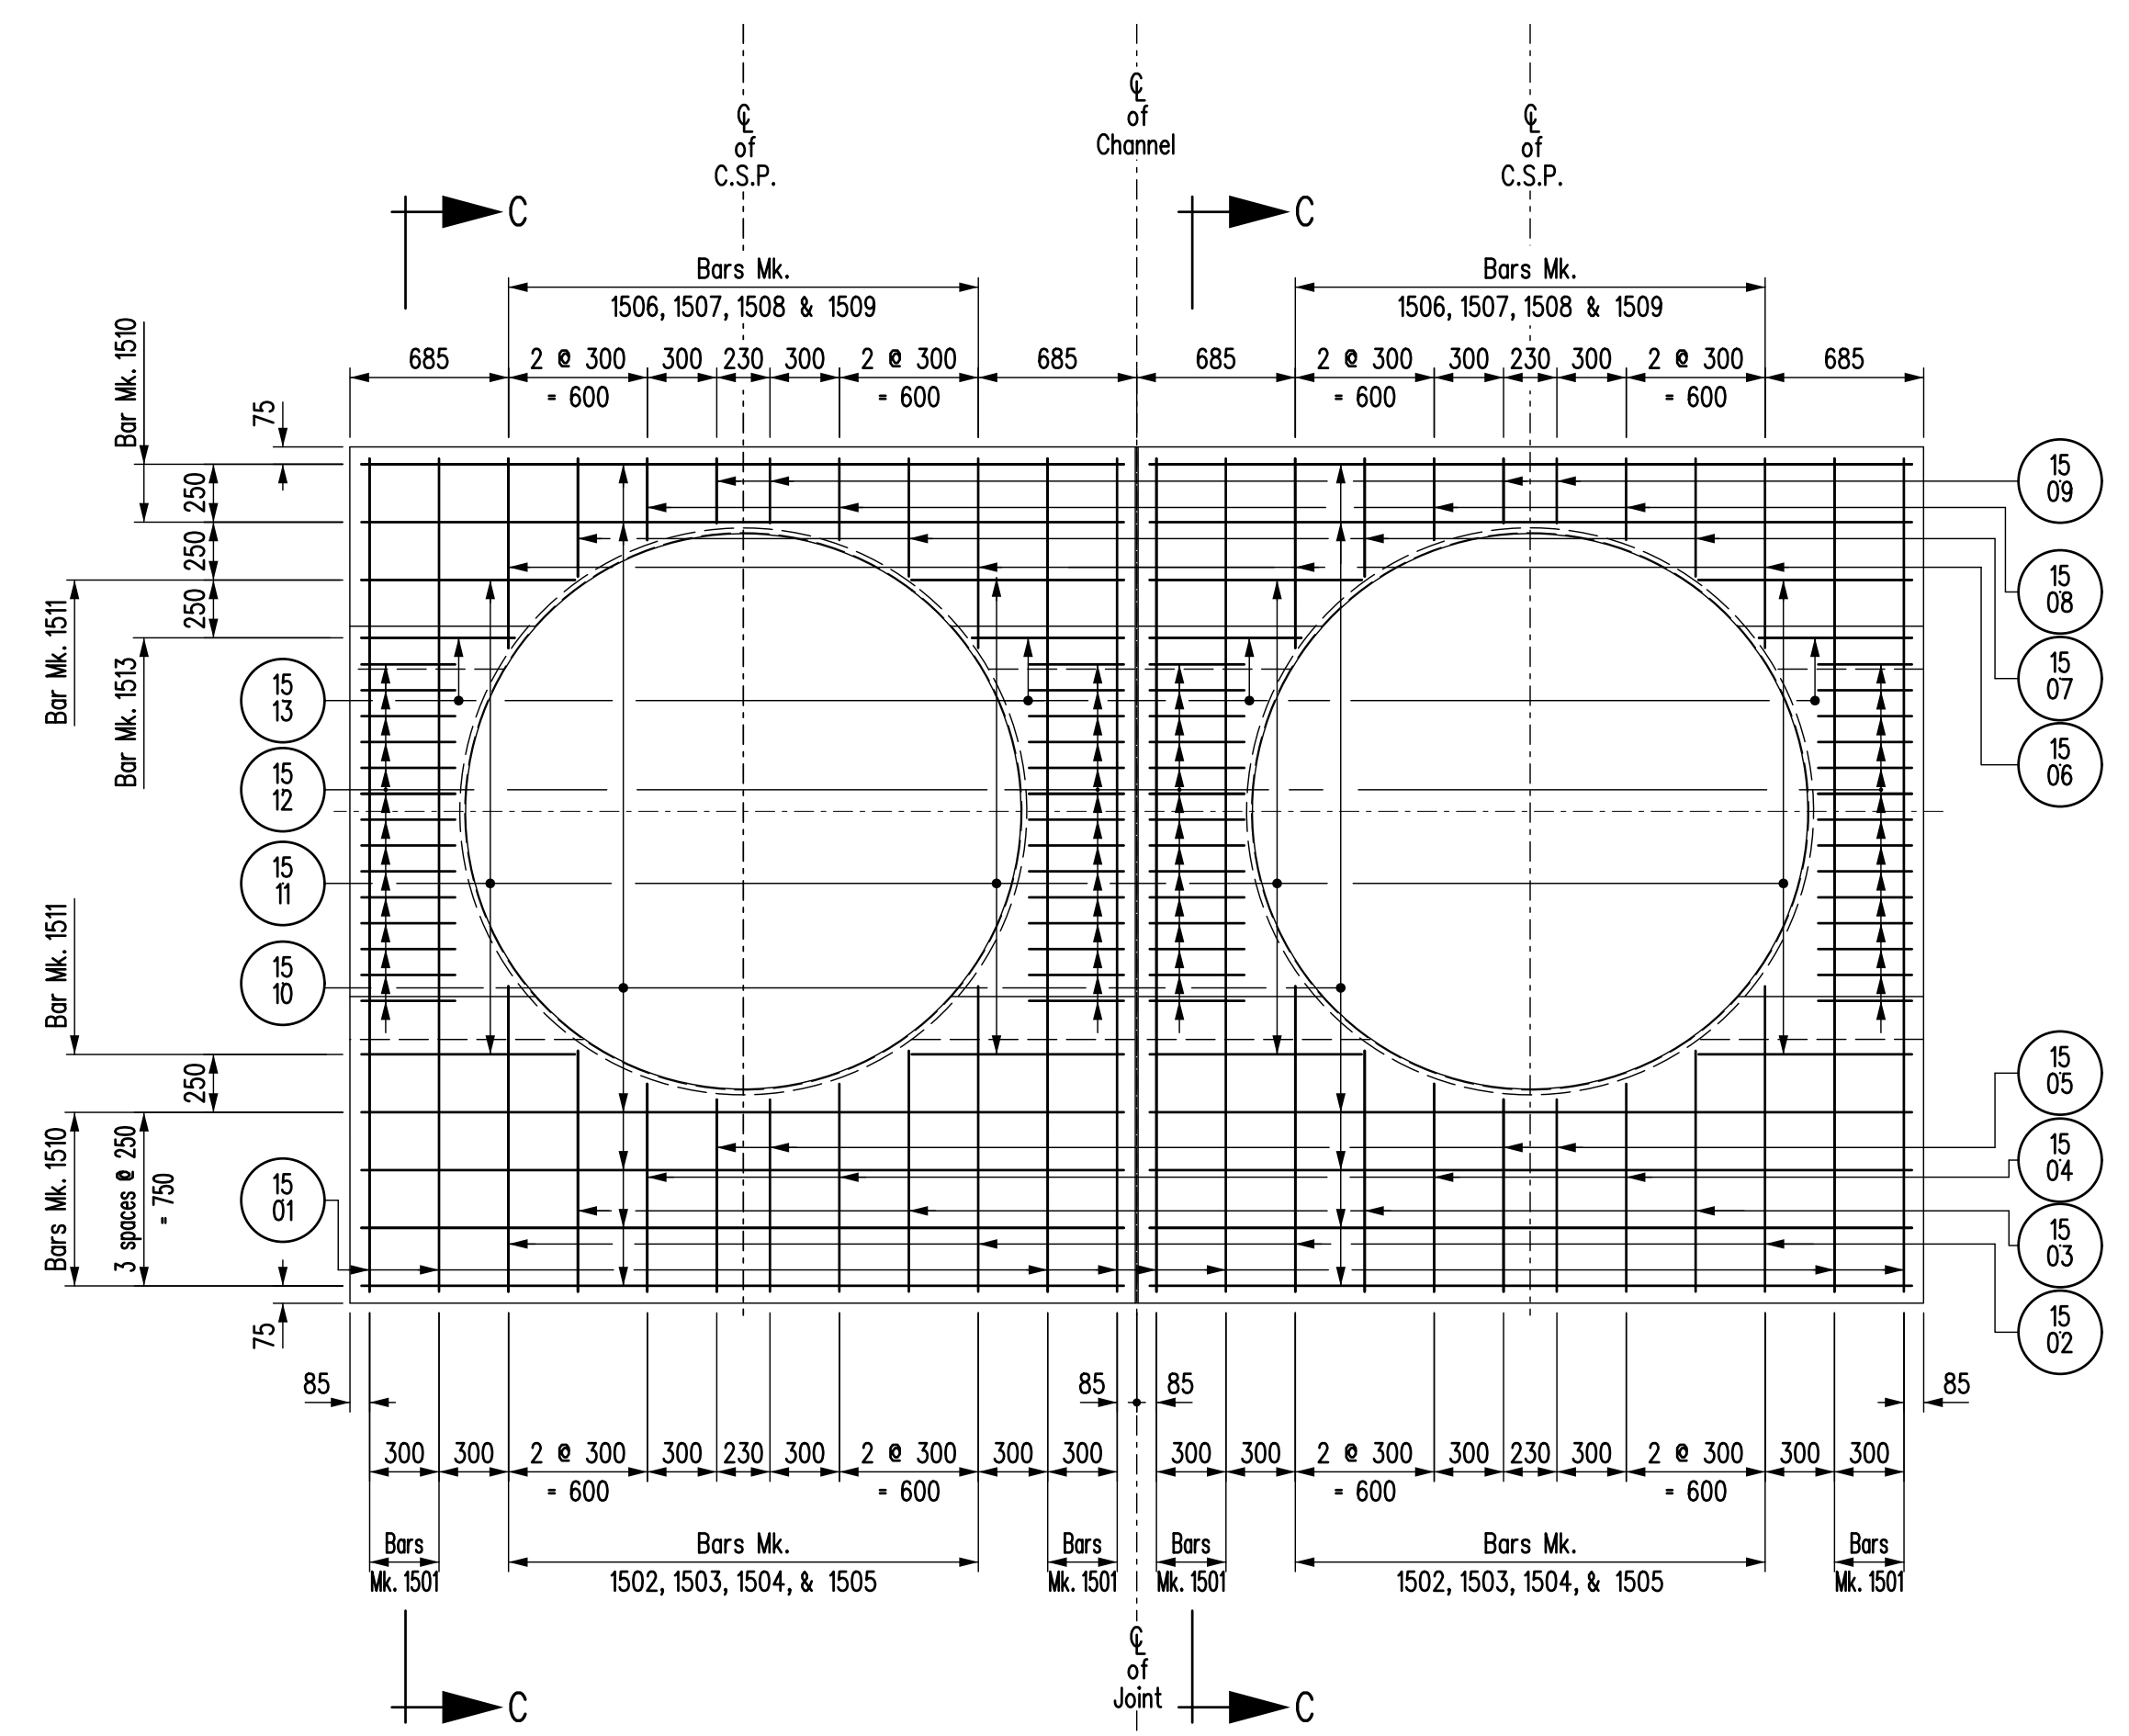

ELEVATION

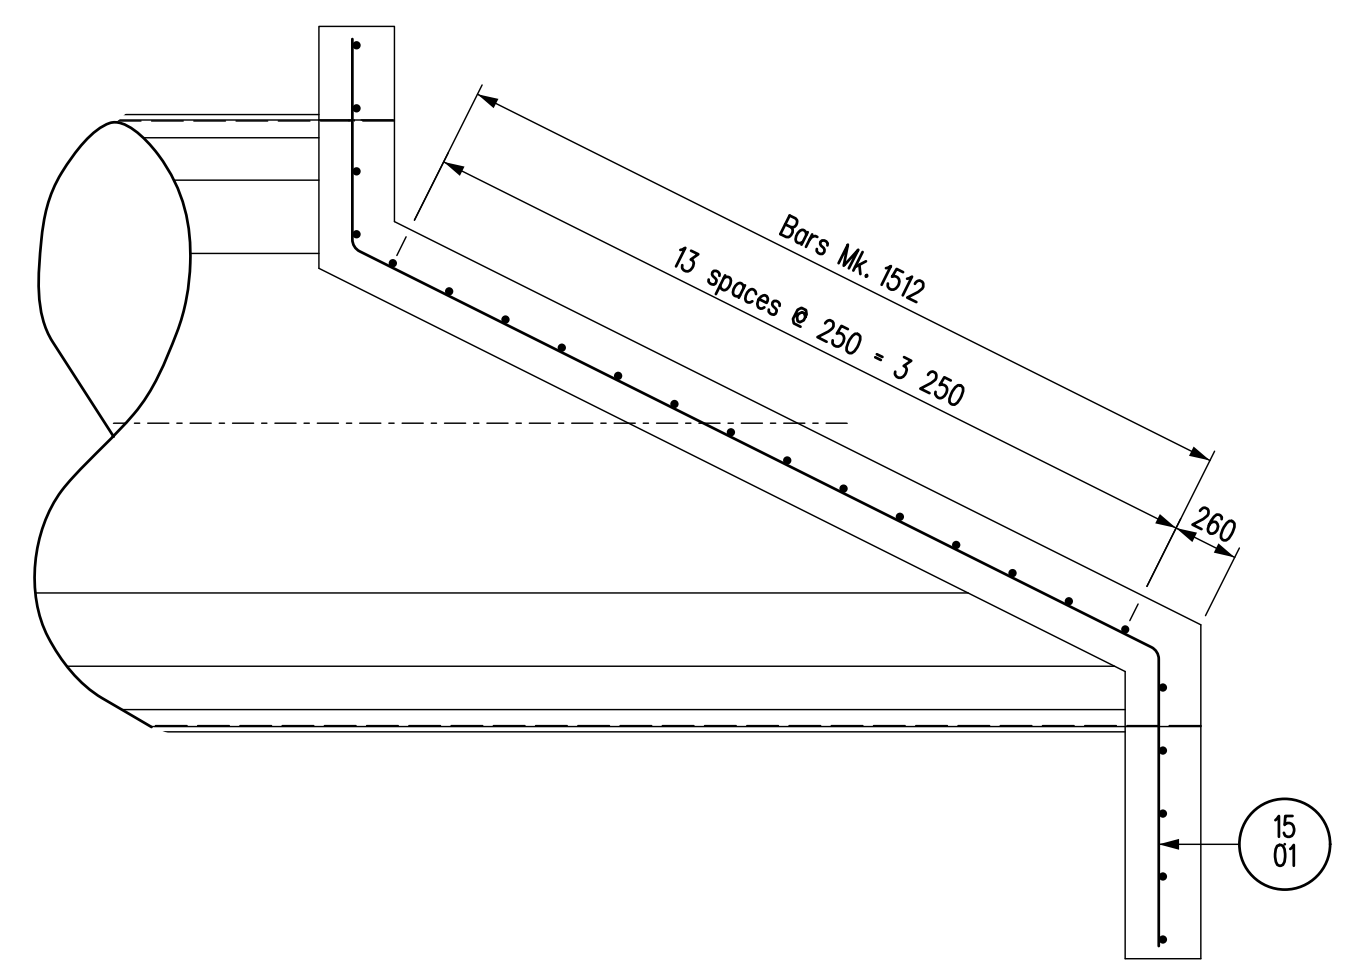

SECTION C-C

BILL OF REINFORCING STEEL FOR 2 REINFORCED CONCRETE HEADWALLS						Site
MARK	TYPE	PN DIAMETER	LENGTH	No.	MASS	BENDING DIAGRAM
1501	BENT	90	5 600	16	140.67	
1502	STR		1 320	8	16.58	
1503	STR		1 040	8	13.06	
1504	STR		900	8	11.30	
1505	STR		830	8	10.42	
1506	STR		820	8	10.30	
1507	STR		510	8	6.41	
1508	STR		350	8	4.40	
1509	STR		280	8	3.52	
1510	STR		3 290	24	123.97	
1511	STR		920	16	23.11	
1512	STR		410	112	72.09	
1513	STR		660	8	8.29	
Total mass of reinforcing steel					444.12	kg
Total volume of structural concrete					12.58	m ³
NOTES:						
1. All dimensions given in bending diagram are out to out, except radii and extensions on 90°, 135° & 180° hooks. Extensions on 90°, 135° & 180° hooks are the "A" or "C" dimensions for the standard 90°, 135° & 180° hooks referenced from the RSIC "Manual of Standard Practice". Radii are inside dimensions. All reinforcing steel bends and hooks shall conform to Clause 6.6.2 of C.S.A. A23.1-04, unless noted otherwise in the BILL OF REINFORCING STEEL.						
2. All reinforcing steel shall be deformed steel, unless noted otherwise in the BILL OF REINFORCING STEEL.						
3. All reinforcing steel shall conform to CSA G30.18-M92 "Billet Steel Bars for Concrete Reinforcement" Grade 400W, unless noted otherwise in the BILL OF REINFORCING STEEL.						
4. Like bars shall be bundled, securely tied and identified as to Mark and Site No. by appropriate means. All other items to be identified in a similar fashion.						
5. Bars marked with the suffix "P" shall be plain unformed bars in accordance with CAN/CSA G40.21-M92 Grade 300W.						
6. All bars shall be bent in accordance with the following detail:						

REVISIONS		HEADWALL DETAILS (REINFORCING) FOR 2 - 2 400 Ø C.S.P.'S	
DATE	BY	DESIGN	APPROVED BY:
		DESIGN SEAL	Original signed by Ruth Eden
		RECORD SEAL	EXECUTIVE DIRECTOR OF STRUCTURES
			DATE June 5, 2014
			SCALE: 1:30 SHEET No. 2 of 2
			or as shown No. SC_ET_RCH_NS_2-2400

BY: A.H.P.
CHECKED: A.K.N.
BY: K.P.
CHECKED: A.H.P.